


POLE MOUNTED TRANSFORMER-RATED METERING (CUSTOMER-OWNED POLE)

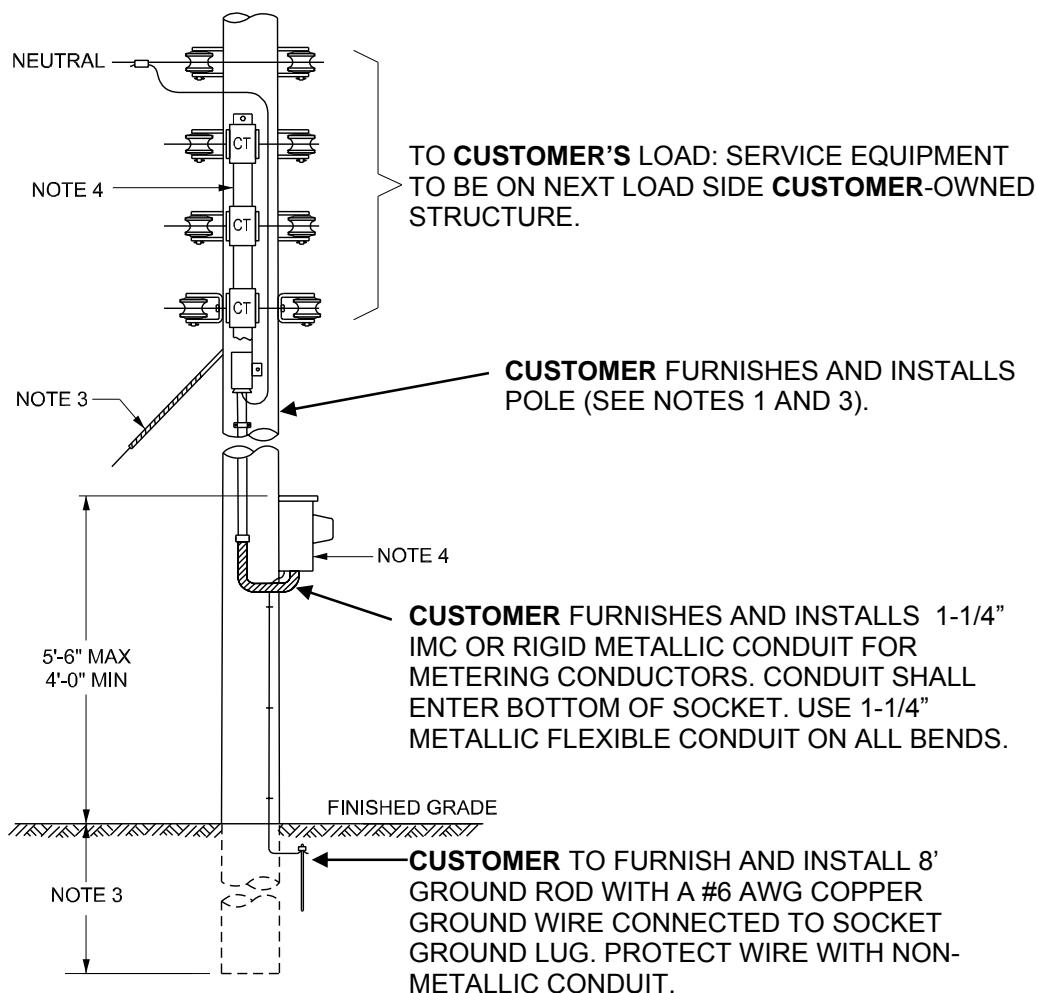

NOTES:

1. **CUSTOMER SHALL CONSULT COMPANY** FOR LOCATION OF POLE.
2. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS OBTAINED (SEE SECTION 4.06) BEFORE COMPANY WILL PROVIDE SERVICE.
3. **CUSTOMER** SHALL FURNISH AND INSTALL COMPANY APPROVED POLE TREATED WITH CHEMICAL PRESERVATIVE. POLE REQUIREMENTS: 30' LENGTH, CLASS 6 (RECOMMENDED); INSTALLED MINIMUM 5' IN GROUND AND WELL TAMPED. IF SERVICE DROP EXCEEDS 50' OR PROPER SETTING DEPTH CANNOT BE OBTAINED, **CUSTOMER** SHALL INSTALL PROPER GUYING. COMPANY WILL BOND GUY TO SERVICE NEUTRAL.
4. METERING TRANSFORMER PACKAGE AND METER SOCKET SUPPLIED BY COMPANY AND INSTALLED BY **CUSTOMER**. NUMBER OF CURRENT AND VOLTAGE TRANSFORMERS WILL VARY WITH SERVICE TYPE.