


# TYPICAL 320 AMP OR LESS OVERHEAD SERVICE INSTALLATION

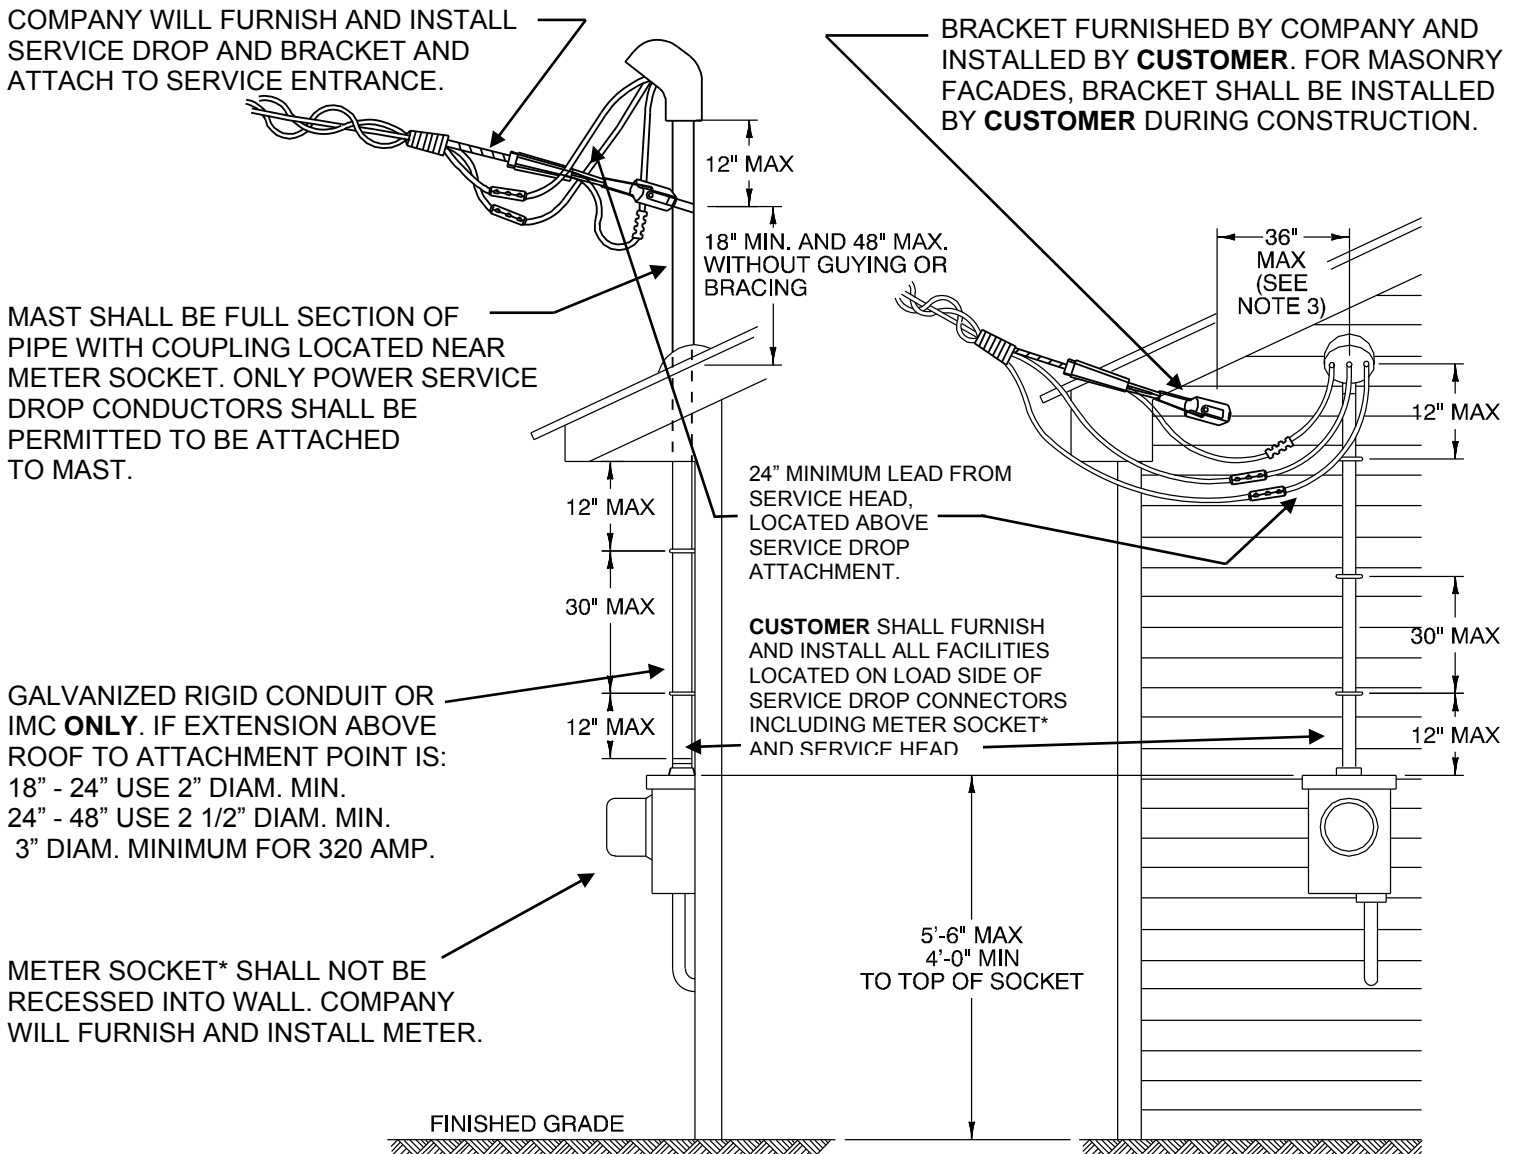

• **WEST VIRGINIA ONLY:** METER SOCKETS FURNISHED BY COMPANY.

**NOTES:**

1. SEE FIGURE 1 FOR MINIMUM GROUND CLEARANCE.
2. SEE FIGURE 2 FOR GROUNDING REQUIREMENTS.
3. **CUSTOMER** SHALL CONSULT COMPANY FOR POINT OF ATTACHMENT OF SERVICE DROP AND METER LOCATION. IF COMPANY AGREES TO ALLOW **CUSTOMER** TO INSTALL BRACKET ABOVE SERVICE HEAD, BRACKET SHALL BE LOCATED NO MORE THAN 24 INCHES FROM SERVICE HEAD.
4. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
5. ALL **CUSTOMER** WORK SHALL BE COMPLETE AND INSPECTIONS OBTAINED (SEE SECTION 4.06) BEFORE COMPANY WILL PROVIDE SERVICE.
6. FOR METER SOCKET SPECIFICATIONS AND MOUNTING, SEE SECTION 9.