


GENERAL OVERHEAD POLE MOUNTED SELF – CONTAINED SERVICE SINGLE OR THREE PHASE BUILDING/STRUCTURE MOUNTED SERVICE EQUIPMENT/MAIN DISCONNECT (EXCLUDES MOBILE HOME AND CENTRAL DISTRIBUTION SERVICE)

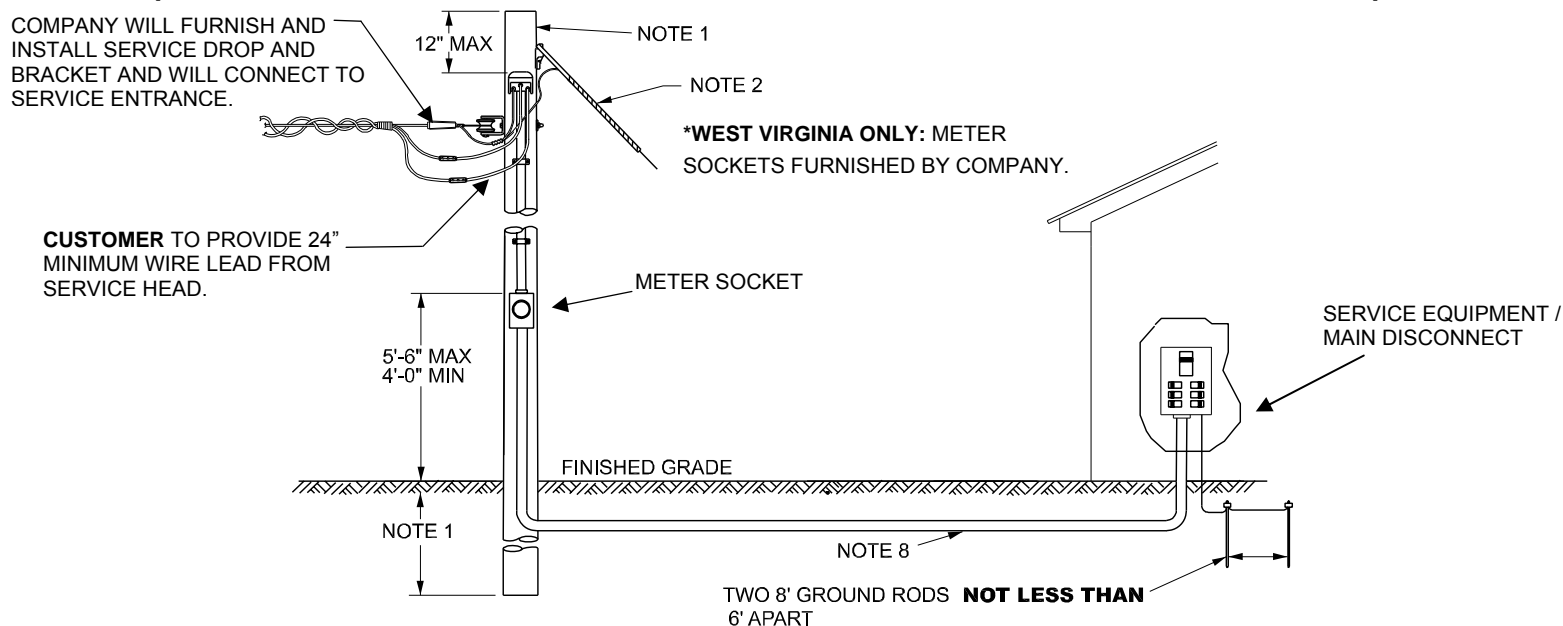

NOTES:

1. **CUSTOMER** SHALL FURNISH AND INSTALL COMPANY APPROVED POLE. POLE REQUIREMENTS: 25' CLASS 7 (RECOMMENDED), CHEMICAL PRESERVATIVE TREATED POLE, INSTALLED MINIMUM 5' IN GROUND AND WELL TAMPED. IF RECOMMENDED POLE HEIGHT NEEDS TO BE EXCEEDED, COMPANY TO BE CONSULTED FOR APPROVAL PRIOR TO POLE BEING SET.
2. IF SERVICE DROP EXCEEDS 100' OR PROPER POLE SETTING DEPTH CANNOT BE OBTAINED, **CUSTOMER** SHALL INSTALL PROPER GUYING. COMPANY WILL BOND GUY TO SERVICE NEUTRAL.
3. **CUSTOMER** SHALL FURNISH AND INSTALL ALL SERVICE ENTRANCE FACILITIES LOCATED ON THE LOAD SIDE OF SERVICE DROP CONNECTORS (INCLUDING METER SOCKET*). COMPANY WILL FURNISH AND INSTALL METER.
4. IF **CUSTOMER'S** SERVICE EQUIPMENT AND MAIN DISCONNECT ARE NOT LOCATED ON THE POLE BELOW THE METER SOCKET, NO ADDITIONAL DISCONNECTING MEANS IS REQUIRED AT THE POLE ON THE LOAD SIDE OF THE METER SOCKET.
5. THE SERVICE ENTRANCE SHALL BE MINIMUM 100 AMP. WITH MAIN DISCONNECT MEANS AND LABELED "SUITABLE FOR USE AS SERVICE EQUIPMENT".
6. **FOR 480/277 VOLT WYE SERVICES (3-PHASE, 4-WIRE), SEE FIGURE 42.** METER DISCONNECT REQUIRED AHEAD OF METER SOCKET.
7. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS OBTAINED (SEE SECTION 4.06) BEFORE COMPANY WILL PROVIDE SERVICE.
8. MINIMUM BURIAL DEPTH OF 24". BURIAL DEPTH MAY BE REDUCED TO 18" IF SERVICE CONDUCTORS ARE IN CONDUIT.
9. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
10. ANTENNAS OR AERIALS SHALL NOT BE ATTACHED TO ANY POLE USED FOR SUPPLYING ELECTRIC SERVICE TO **CUSTOMERS**.