


POLE MOUNTED SELF-CONTAINED METER NOT EXCEEDING 320 AMPS, CUSTOMER CENTRAL DISTRIBUTION SERVICE WITH STAND-BY GENERATOR FACILITIES

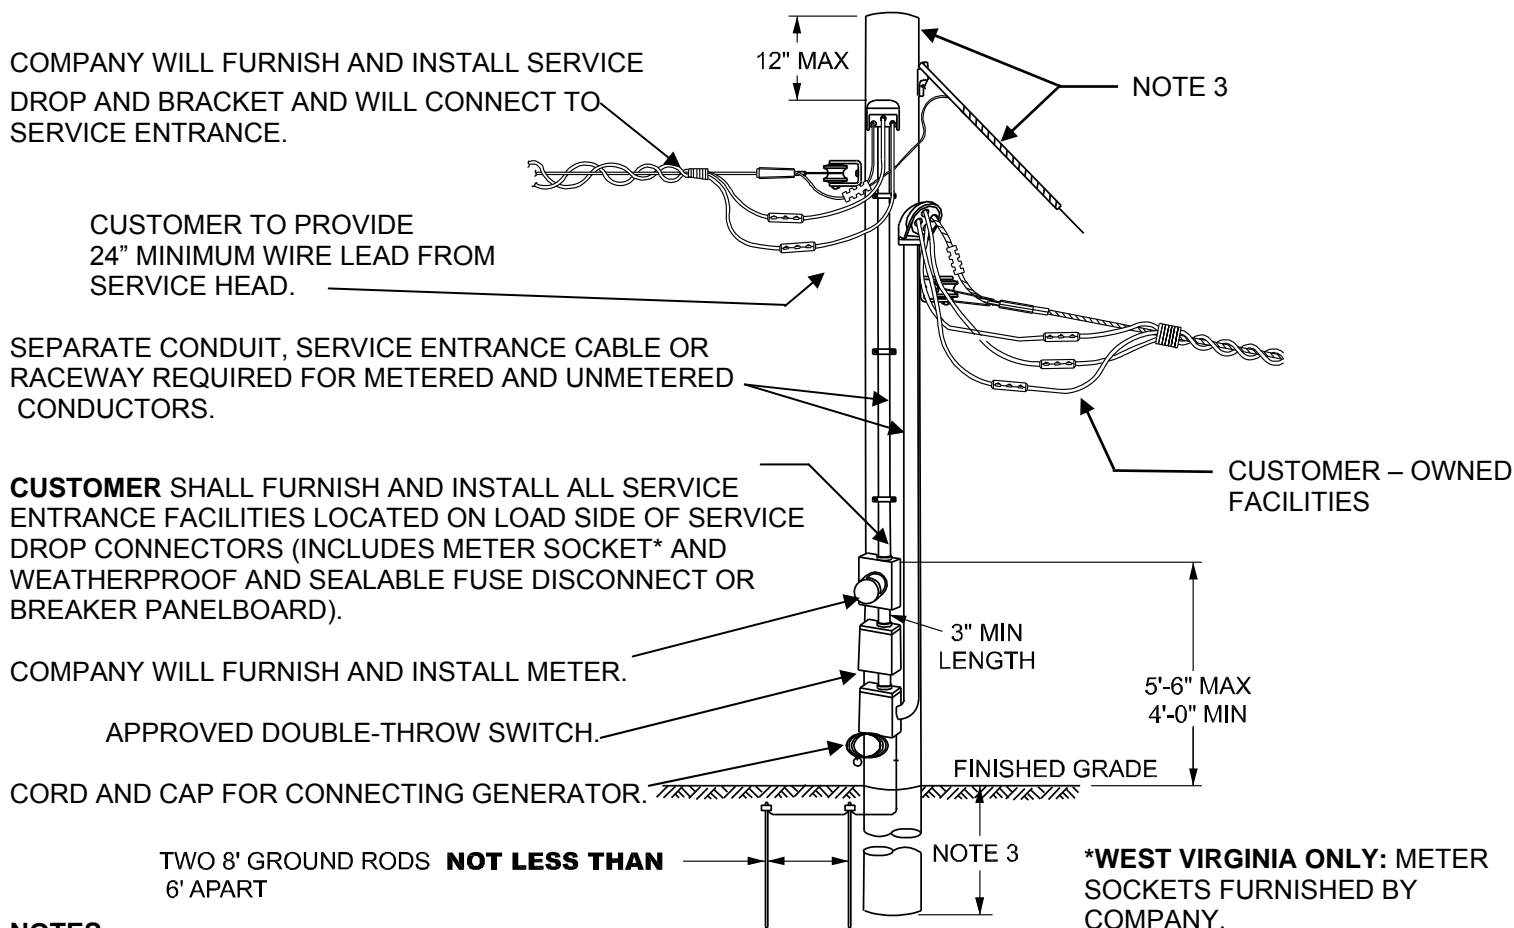

NOTES:

1. **CUSTOMER SHALL CONSULT WITH COMPANY** BEFORE INSTALLING CENTRAL DISTRIBUTION SERVICE.
2. ALL EMERGENCY STAND-BY GENERATOR FACILITIES SHALL BE INSTALLED IN ACCORDANCE WITH APPLICABLE CODES AND BE SUBJECT TO COMPANY APPROVAL.
3. **CUSTOMER** SHALL FURNISH AND INSTALL COMPANY APPROVED POLE TREATED WITH CHEMICAL PRESERVATIVE. POLE REQUIREMENTS: 30' LENGTH, CLASS 6 (RECOMMENDED); INSTALLED MINIMUM 5' IN GROUND AND WELL TAMPED. IF SERVICE DROP EXCEEDS 100' OR PROPER SETTING DEPTH CANNOT BE OBTAINED, **CUSTOMER** SHALL INSTALL PROPER GUYING. COMPANY WILL BOND GUY TO SERVICE NEUTRAL. IF RECOMMENDED POLE HEIGHT NEEDS TO BE EXCEEDED, COMPANY TO BE CONSULTED FOR APPROVAL PRIOR TO POLE BEING SET.
4. ANTENNAS OR AERIALS SHALL NOT BE ATTACHED TO ANY POLE USED FOR SUPPLY OF ELECTRIC SERVICE TO **CUSTOMER**.
5. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
6. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS OBTAINED (SEE SECTION 4.06) BEFORE COMPANY WILL PROVIDE SERVICE.
7. WHEN LOAD EXCEEDS 320 AMPS, SEE FIGURE 11.