


TEMPORARY UNDERGROUND SERVICE SUPPORT AT TRANSFORMER

CUSTOMER SHALL FURNISH, INSTALL AND CONNECT ALL INTERNAL WIRING FOR METER SOCKETS* AND WEATHERPROOF, SEALABLE FUSE OR BREAKER TYPE DISCONNECTING MEANS. MINIMUM SIZE METER SOCKET TO BE INSTALLED IS 100 AMP. COMPANY WILL FURNISH AND INSTALL METER. ALL 125 VOLT RECEPTACLE OUTLETS SHALL HAVE GROUND FAULT CIRCUIT INTERRUPTER PROTECTION.

CUSTOMER SHALL FURNISH AND INSTALL ALL SERVICE ENTRANCE FACILITIES AND 2" MINIMUM CONDUIT EXTENDING TO GROUND LINE FOR SERVICE LATERAL.

COMPANY WILL FURNISH AND CONNECT SERVICE LATERAL FROM TRANSFORMER TO METER SOCKET.

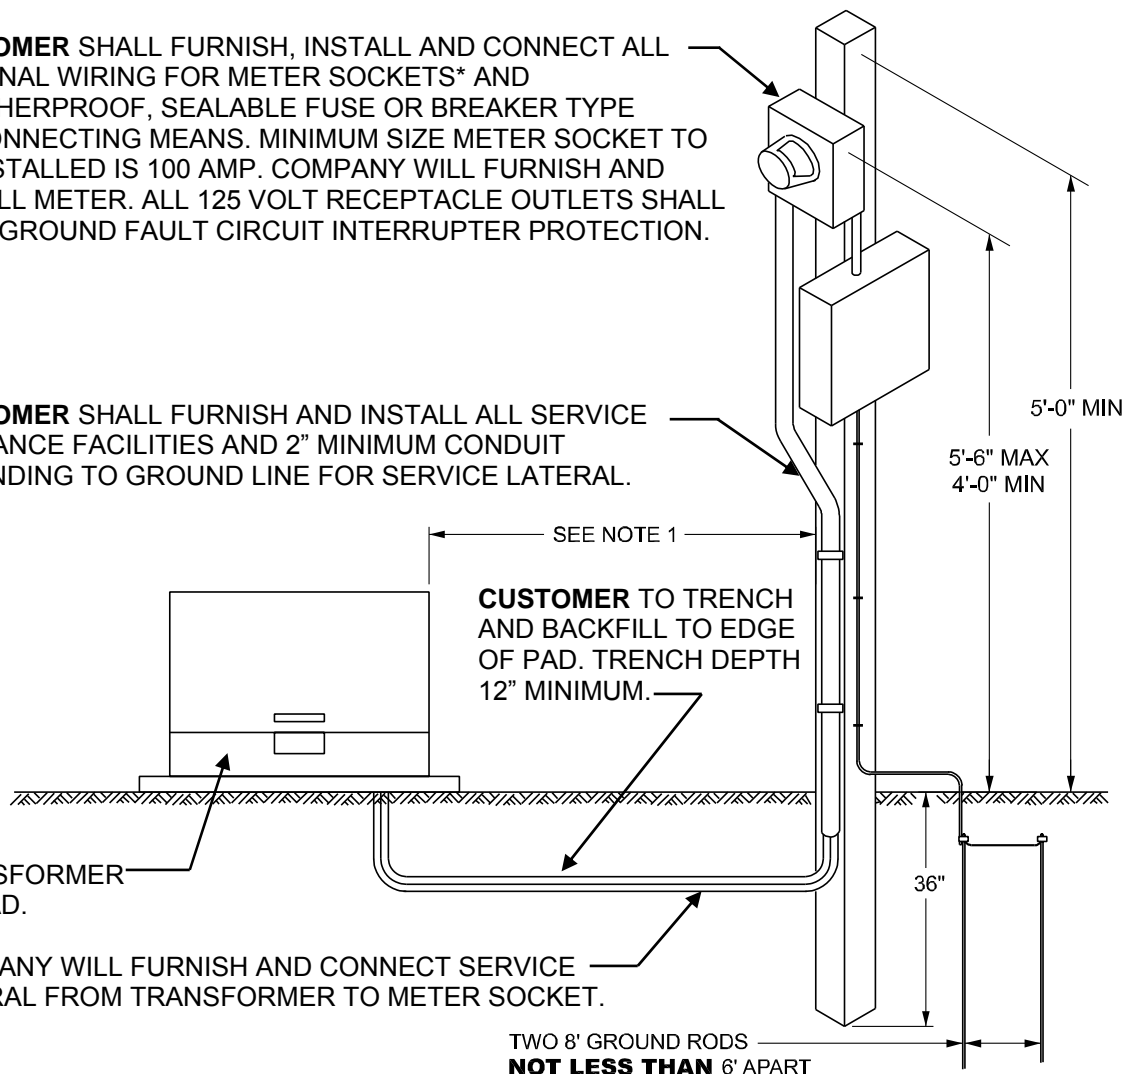

CUSTOMER TO TRENCH AND BACKFILL TO EDGE OF PAD. TRENCH DEPTH 12" MINIMUM.

TWO 8' GROUND RODS NOT LESS THAN 6' APART

***WEST VIRGINIA ONLY:** METER SOCKETS FURNISHED BY COMPANY.

NOTES:

1. **CUSTOMER** SHALL CONSULT WITH COMPANY FOR LOCATION OF TEMPORARY SERVICE POST OR SUPPORT. SUCH SUPPORT SHALL BE LOCATED WITHIN 5' OF COMPANY'S TRANSFORMER OR SECONDARY, UNLESS OTHERWISE APPROVED BY COMPANY.
2. **CUSTOMER** SHALL FURNISH AND INSTALL A NOMINAL 4" X 4" X 8', PRESSURE TREATED POST OR OTHER COMPANY APPROVED SUPPORT.
3. **CUSTOMER** SHALL TRENCH AND BACKFILL FOR COMPANY SERVICE LATERAL CONDUCTORS. TRENCH TO BE EXCAVATED IN LOCATION INDICATED BY COMPANY.
4. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
5. ALL **CUSTOMER** WORK SHALL BE COMPLETED, ARRANGEMENTS MADE FOR PAYMENT OF APPLICABLE CHARGES AND INSPECTIONS OBTAINED (SEE SECTION 4.06) BEFORE COMPANY WILL PROVIDE SERVICE.