


UNDERGROUND TRANSFORMER-RATED METERING INSTALLATION (3-PHASE, 4-WIRE SERVICE)

CONSULT COMPANY FOR DETAILS BEFORE INSTALLATION.

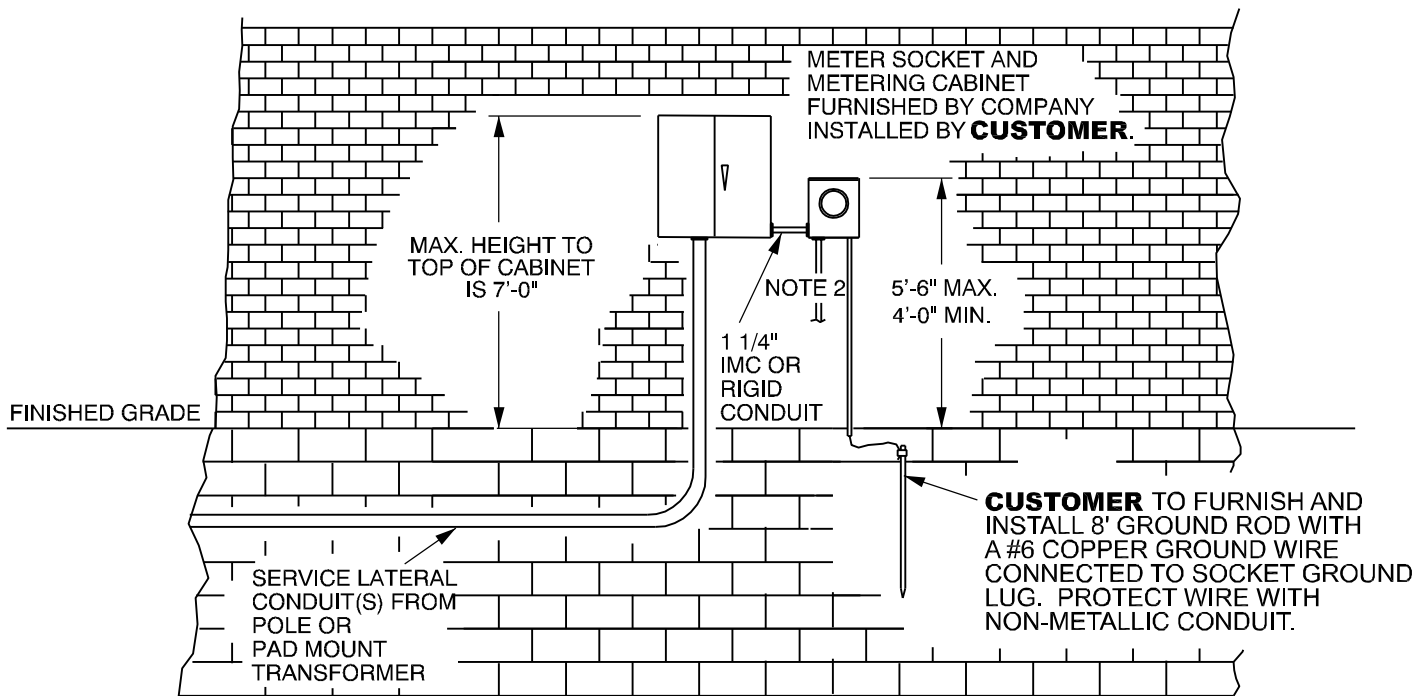

NOTES:

1. FOR METERING LOCATED ON BUILDING, SERVICE LATERAL CONDUIT(S) SHALL BE FURNISHED AND INSTALLED BY **CUSTOMER**, OWNED AND MAINTAINED BY COMPANY. TRENCHING AND BACKFILLING IS RESPONSIBILITY OF **CUSTOMER**. CONDUIT SHALL HAVE WEEP HOLES AT GROUND LINE WHEN REQUIRED. **CUSTOMER** TO FURNISH A 1/4" NYLON OR POLYPROPYLENE PULL ROPE IN THE SERVICE LATERAL CONDUIT(S). COMPANY WILL PROVIDE AND INSTALL ALL SERVICE LATERAL CONDUCTORS.
2. **CUSTOMER** SHALL FURNISH AND INSTALL 1-1/4" DIAMETER CONDUIT WITH 1/4" NYLON OR POLYPROPYLENE PULL ROPE FROM METER SOCKET TO LOCATION AT CUSTOMER'S BUILDING WHERE TELEPHONE LINE SERVICE CAN BE MADE AVAILABLE AT THE TELEPHONE DEMARCATION POINT (SEE SECTION 8.08).
3. SERVICE LATERAL INSTALLED IN CONDUIT SHALL BE INSTALLED AS A-B-C-N IN EACH CONDUIT.
4. COMPANY WILL PROVIDE ALL CONNECTORS AND MAKE ALL CONNECTIONS AT METERING CABINET.
5. **CUSTOMER** SHALL GIVE COMPANY ADEQUATE ADVANCE NOTICE AS TO NUMBER AND SIZE OF CONDUCTORS **CUSTOMER** WILL INSTALL.