


TYPICAL TRANSFORMER-RATED METERING INSTALLATION AT PAD-MOUNTED TRANSFORMER (3-PHASE, 4-WIRE SERVICE)

CONSULT COMPANY FOR DETAILS BEFORE INSTALLATION.

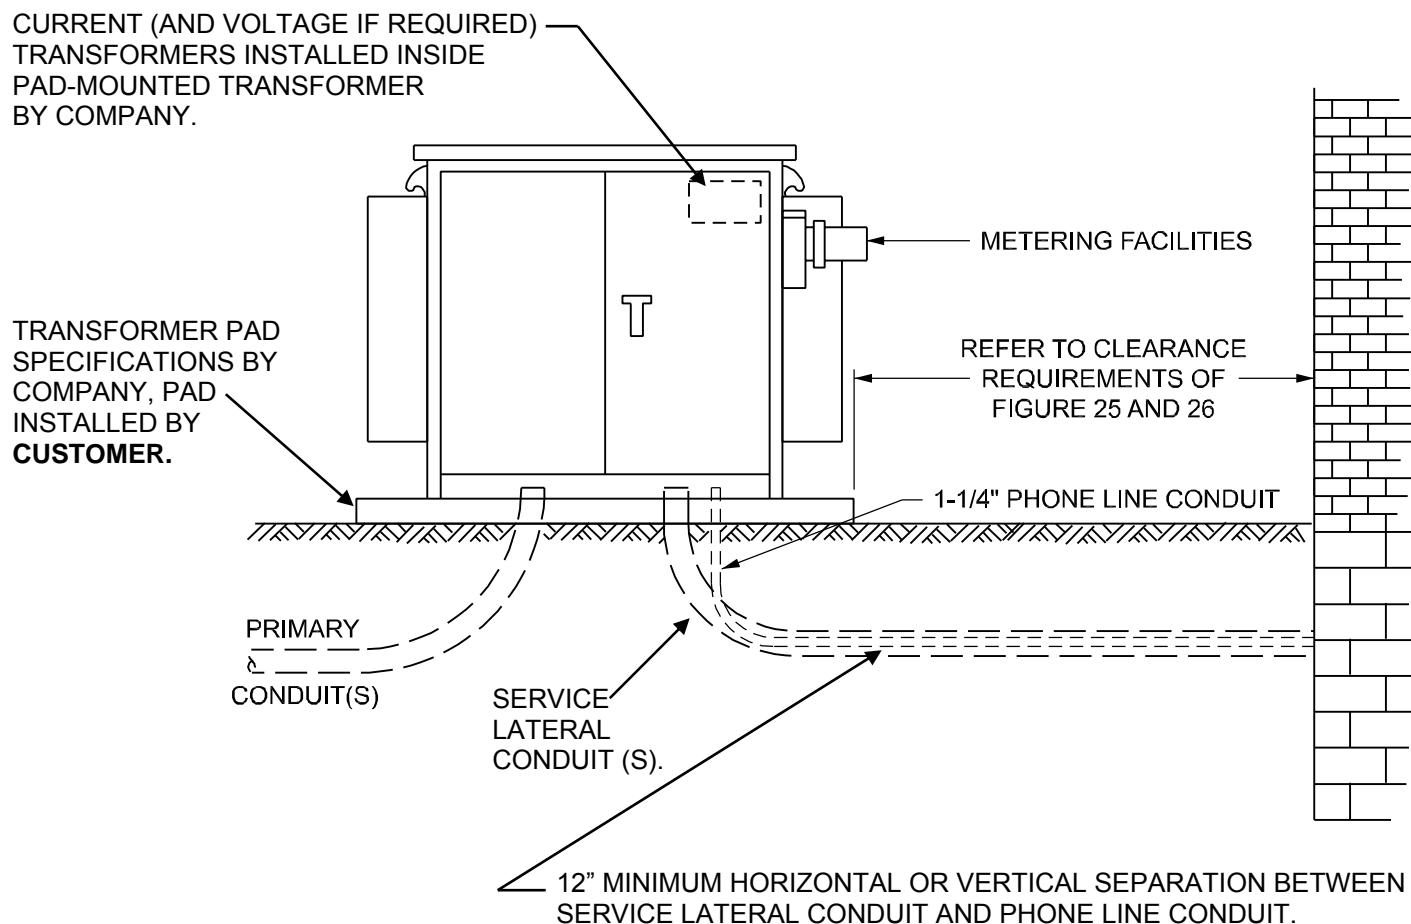

NOTES:

1. FOR METERING LOCATED AT PAD-MOUNTED TRANSFORMER, SERVICE LATERAL SHALL BE FURNISHED, INSTALLED, OWNED AND MAINTAINED BY **CUSTOMER** (SEE SECTION 6.03). IN ADDITION TO SERVICE LATERAL CONDUIT, **CUSTOMER** SHALL FURNISH AND INSTALL 1-1/4" DIAMETER CONDUIT WITH 1/4" NYLON PULL ROPE FROM SECONDARY COMPARTMENT OF PAD-MOUNTED TRANSFORMER TO LOCATION AT **CUSTOMER'S** BUILDING WHERE TELEPHONE LINE SERVICE CAN BE MADE AVAILABLE AT THE TELEPHONE DEMARCATION POINT (SEE SECTION 8.08).
2. TRENCHING AND BACKFILLING SHALL BE DONE BY THE **CUSTOMER**.
3. SERVICE LATERAL INSTALLED IN CONDUIT SHALL BE INSTALLED AS A-B-C-N IN EACH CONDUIT.
4. CONDUIT SHALL HAVE WEEP HOLES AT GROUND LINE WHEN REQUIRED.
5. COMPANY WILL PROVIDE ALL CONNECTORS AND MAKE ALL CONNECTIONS AT TRANSFORMER.
6. **CUSTOMER** SHALL GIVE COMPANY ADEQUATE ADVANCE NOTICE AS TO NUMBER AND SIZE OF CONDUCTORS **CUSTOMER** WILL INSTALL.
7. BARRIERS MAY BE REQUIRED BY COMPANY FOR PROTECTION OF TRANSFORMER FROM VEHICULAR DAMAGE.