


CLEARANCES OF PAD-MOUNTED EQUIPMENT FROM SHRUBS, PLANTS AND OTHER OBSTRUCTIONS

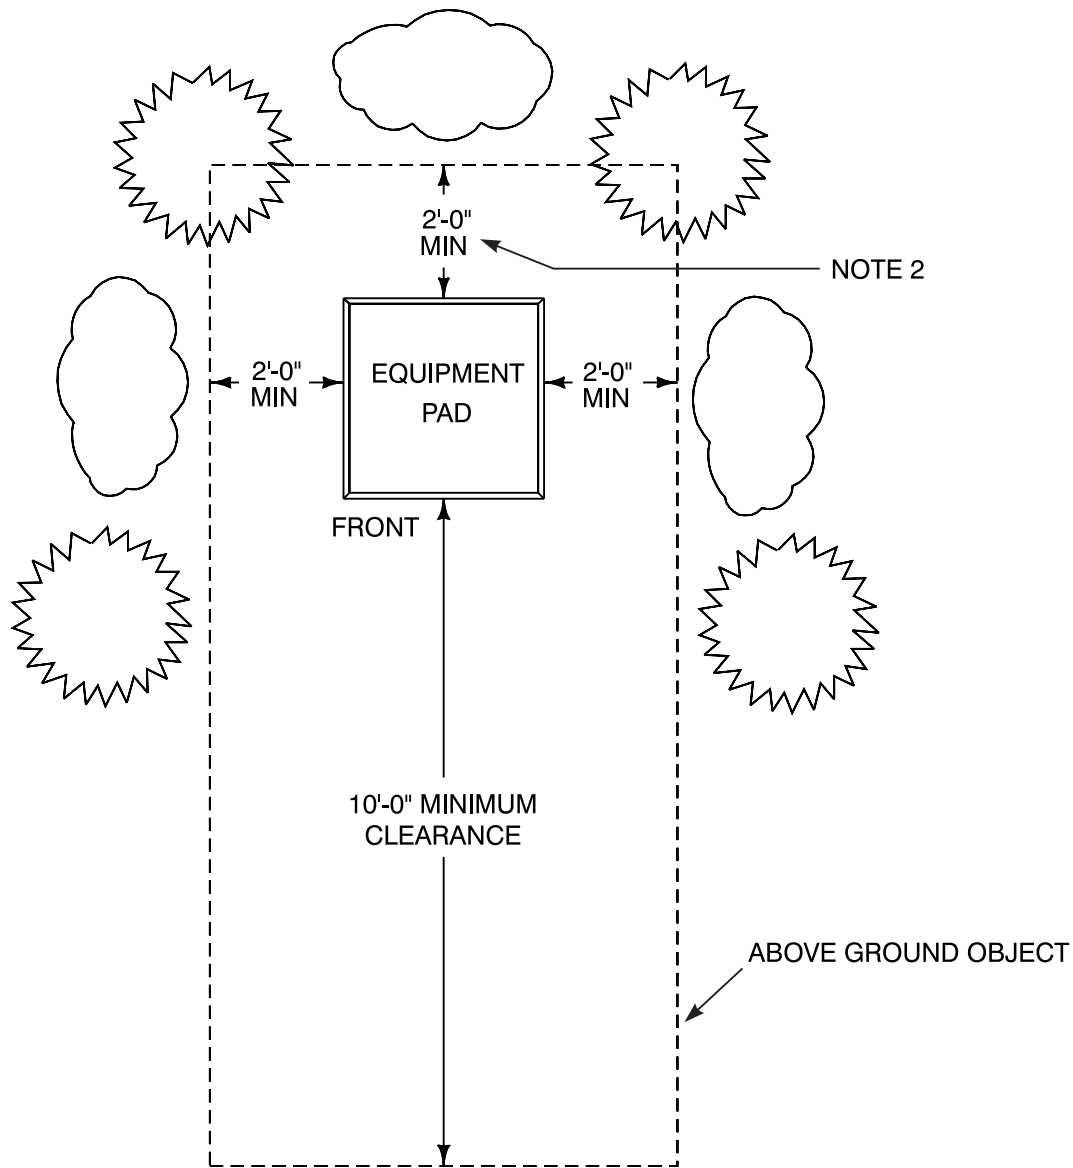

NOTES:

1. 2' MINIMUM DIMENSION IS CLEARANCE THAT SHALL BE MAINTAINED WHEN PLANTS REACH MATURITY. ALLOW ADEQUATE SPACE FOR FUTURE GROWTH, AND AVOID PLANTING SHRUBS OR SETTING POSTS DIRECTLY OVER CABLES.
2. IF PAD-MOUNTED EQUIPMENT IS SWITCH OR OTHER SIMILAR DEVICE WITH FRONT AND REAR DOORS, THIS DISTANCE SHALL BE INCREASED TO 10'.
3. WARNING - PAD-MOUNTED TRANSFORMER AND PAD-MOUNTED EQUIPMENT HAVE UNDERGROUND ELECTRIC CABLES ENTERING AND EXITING THEM BELOW GRADE. WHEN IT IS DECIDED TO INSTALL PLANTS AROUND PAD, CALL APPROPRIATE TOLL FREE NUMBER FOUND IN SECTION 6.10 OR ON BACK COVER OF THIS BOOK BEFORE DIGGING SO THAT UNDERGROUND CABLE LOCATIONS CAN BE DETERMINED.