


PAD FOUNDATION PAD-MOUNTED TRANSFORMER SINGLE PHASE

CONSULT COMPANY FOR DETAILS BEFORE INSTALLATION.

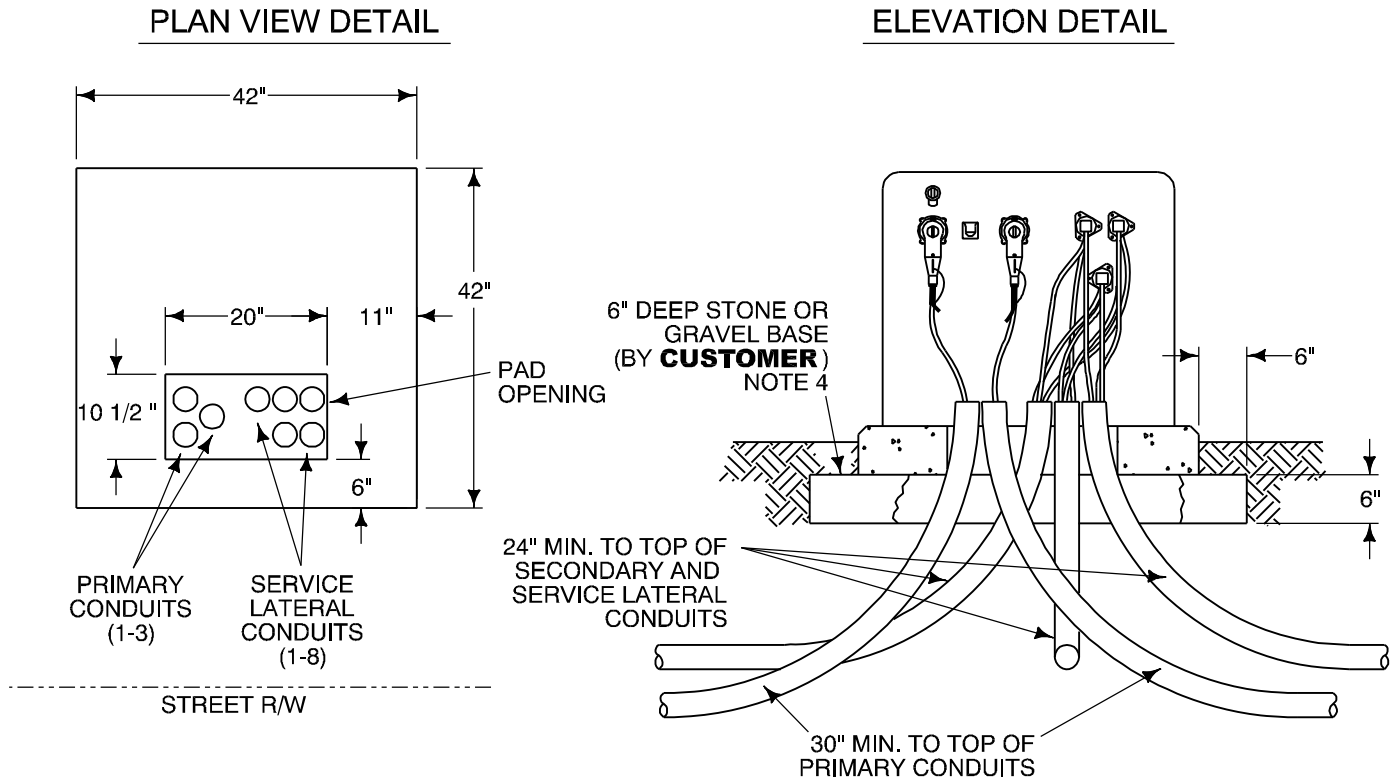

NOTES:

1. PRIMARY CONDUITS ARE LOCATED ON THE LEFT SIDE OF THE PAD OPENING.
2. SERVICE LATERAL CONDUITS ARE LOCATED ON THE RIGHT SIDE OF THE PAD OPENING.
3. ELEVATION DETAIL IS LOOKING FROM THE STREET SIDE OF THE TRANSFORMER.
4. THE **CUSTOMER** IS RESPONSIBLE FOR SITE PREPARATIONS (GRAVEL, CONDUIT, ETC.). **COMPANY** SHALL FURNISH TRANSFORMER PADS FURNISH AND INSTALL GROUND RODS AND GROUNDING CONNECTIONS. THE **CUSTOMER** SHALL PROVIDE A 6' WIDE BY 6' LONG, CLEAR LEVEL AREA AT THE TRANSFORMER PAD SITE WITH PAD TO BE CENTERED IN THE AREA. THE PAD SITE SHALL BE ELEVATED SLIGHTLY SUCH THAT SURFACE WATER WILL NOT ENTER PAD SLOT OR CONDUITS. A 6" DEEP CRUSHED STONE OR GRAVEL BASE SHALL BE INSTALLED ON FIRM OR TAMPED SOIL UNDER THE ENTIRE PAD AND SHALL EXTEND 6" BEYOND ALL SIDES OF THE PAD. PROVIDE A CLEAR, LEVEL AREA OF APPROXIMATELY PAD WIDTH TO A DISTANCE OF 10' TO THE FRONT OF THE PAD FOR OPERATION PURPOSES.