

# SELF-CONTAINED METER SOCKET CONNECTIONS

OVERHEAD ONLY




120/240 VOLT  
3 WIRE  
SINGLE-PHASE  
100 AND 200 AMP.

UNDERGROUND ONLY




120/240 VOLT  
3 WIRE  
SINGLE-PHASE  
200 AMP.

UNDERGROUND

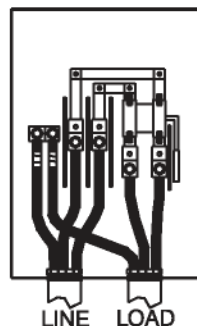


120/240 VOLT  
3 WIRE  
SINGLE-PHASE  
320 AMP.

OVERHEAD

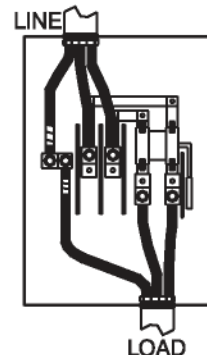

120/240 VOLT  
3 WIRE  
SINGLE-PHASE  
320 AMP.

OVERHEAD ONLY



120/208 VOLT  
3 WIRE  
SINGLE-PHASE  
100 AND 200 AMP.


UNDERGROUND ONLY



120/208 VOLT  
3 WIRE  
SINGLE-PHASE  
(NETWORK)  
200 AMP

120/208 VOLT SINGLE-PHASE  
(NETWORK) METER SOCKETS  
REQUIRE FIFTH TERMINAL (JAW)  
MOUNTED IN 9 O'CLOCK POSITION

OVERHEAD ONLY

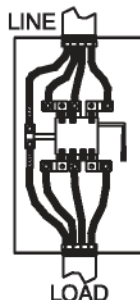


208Y/120 VOLT  
240/120 VOLT\*  
480Y/277 VOLT†  
4 WIRE  
THREE-PHASE  
200 AMP.

\* PUT HIGH PHASE OF 240/120  
VOLT DELTA ON RIGHT JAW OF  
METER SOCKET.

† SEE FIGURES 42 AND 43 FOR  
480Y/277 VOLT INSTALLATIONS.

UNDERGROUND  
OR OVERHEAD

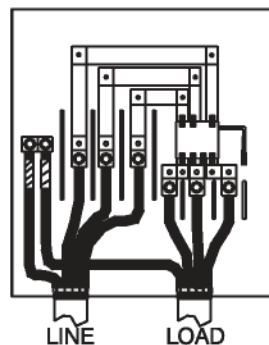

208Y/120 VOLT  
240/120 VOLT\*  
480Y/277 VOLT†  
4 WIRE  
THREE-PHASE  
320 AMP.

**NOTES:**

1. ALL METER SOCKETS SHALL BE RINGLESS-TYPE AND SUITABLE FOR PLUG-IN METERS.
2. INHIBITOR COMPOUND SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.