


WIRING TROUGH INSTALLATION WITH METERING TRANSFORMER CABINET

FIG.46

CONSULT COMPANY FOR DETAILS BEFORE INSTALLATION.

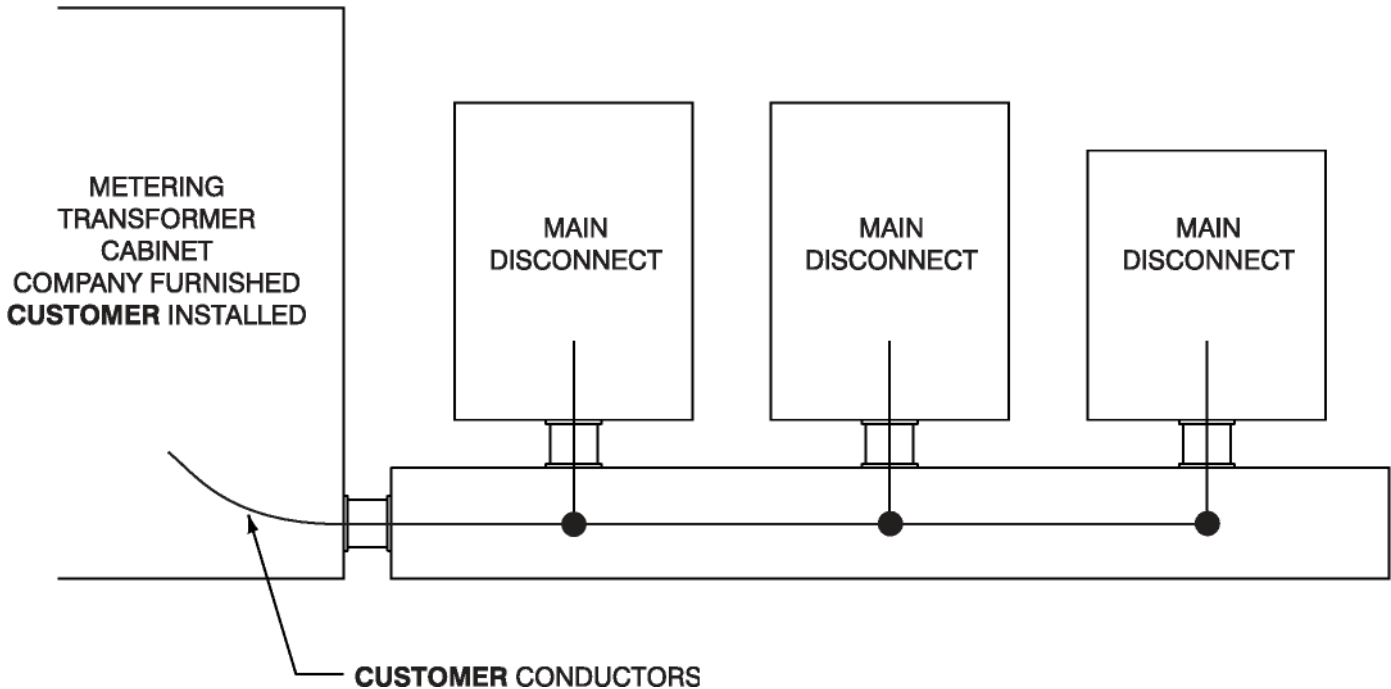

NOTES:

1. **CUSTOMER'S** LOAD CONDUCTORS SHALL EXTEND INTO METERING TRANSFORMER CABINET AT LEAST 48 INCHES.
2. COMPANY WILL FURNISH SUITABLE CONNECTORS AND CONNECT ITS UNDERGROUND CONDUCTORS AND **CUSTOMER'S** CONDUCTORS TO METERING TRANSFORMERS WITHIN CABINET.
3. WHEN OVERHEAD SERVICE IS PROVIDED, **CUSTOMER** SHALL FURNISH ALL SERVICE ENTRANCE CONDUCTORS.