


# POLE MOUNTED TRANSFORMER-RATED METERING (CUSTOMER-OWNED POLE)

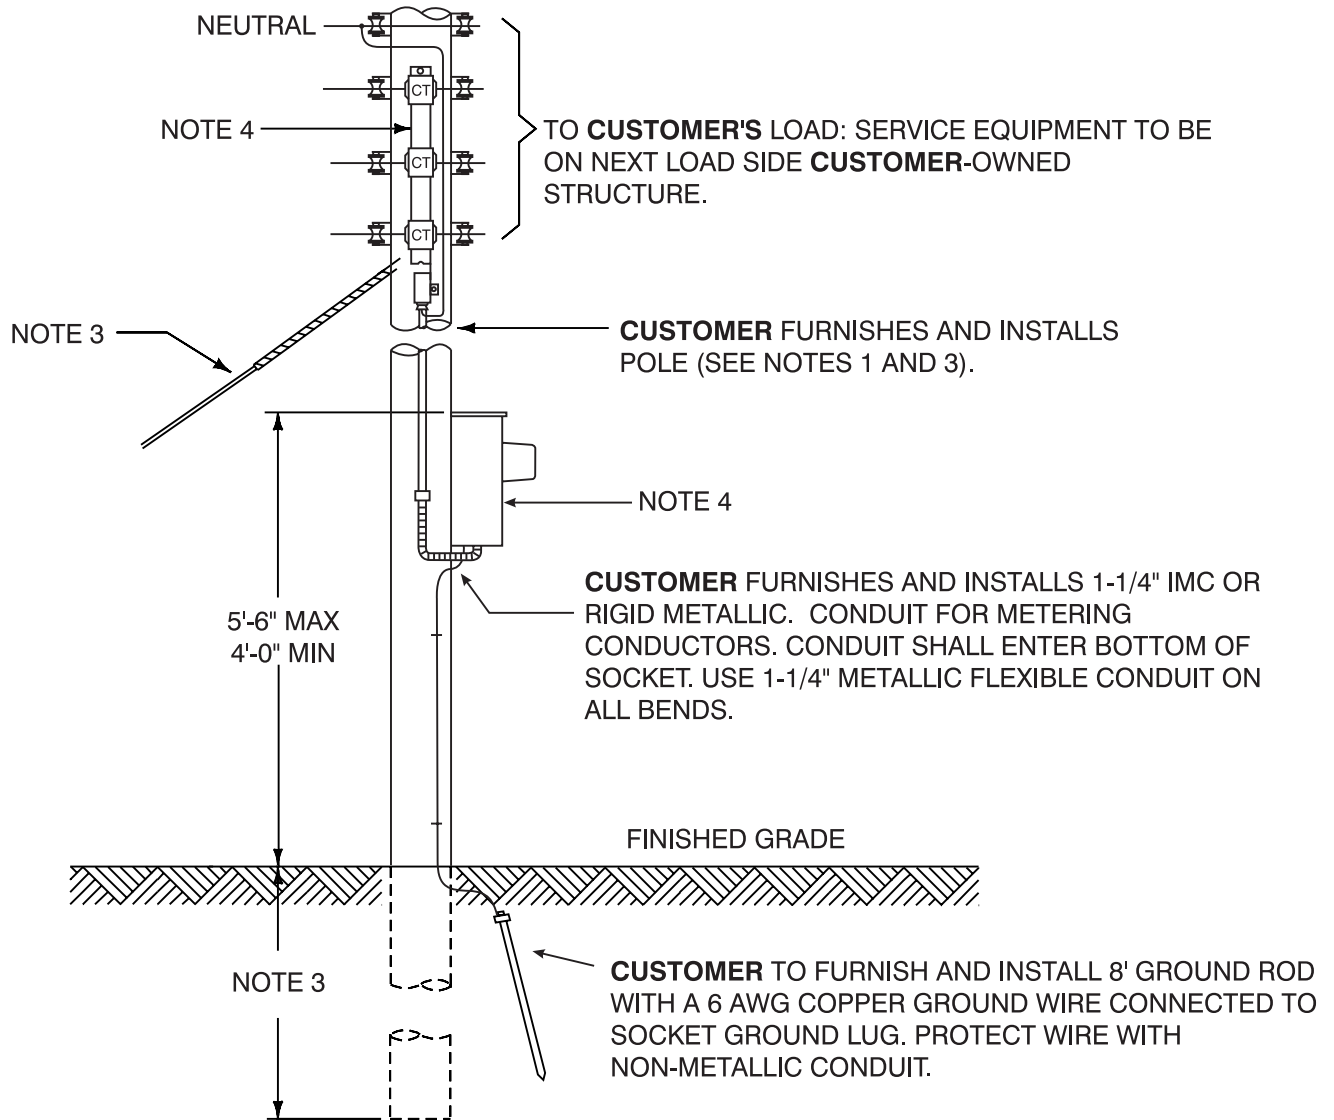

**NOTES:**

1. **CUSTOMER SHALL CONSULT COMPANY** FOR LOCATION OF POLE.
2. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS (SEE SECTION 4.06) OBTAINED BEFORE COMPANY WILL PROVIDE SERVICE.
3. **CUSTOMER** SHALL FURNISH AND INSTALL COMPANY APPROVED POLE TREATED WITH CHEMICAL PRESERVATIVE. MINIMUM POLE REQUIREMENTS: 30' LENGTH, CLASS 6; INSTALLED MINIMUM 5' IN GROUND AND WELL TAMPED. IF SERVICE DROP EXCEEDS 50' OR PROPER SETTING DEPTH CANNOT BE OBTAINED, **CUSTOMER** SHALL INSTALL PROPER GUYING. COMPANY WILL BOND GUY TO SERVICE NEUTRAL.
4. METERING TRANSFORMER PACKAGE AND METER SOCKET SUPPLIED BY COMPANY AND INSTALLED BY CUSTOMER. NUMBER OF CURRENT AND VOLTAGE TRANSFORMERS WILL VARY WITH SERVICE TYPE.