


TYPICAL UNDERGROUND MOBILE HOME SERVICE FOR PARKS OR INDIVIDUALLY LOCATED HOMES

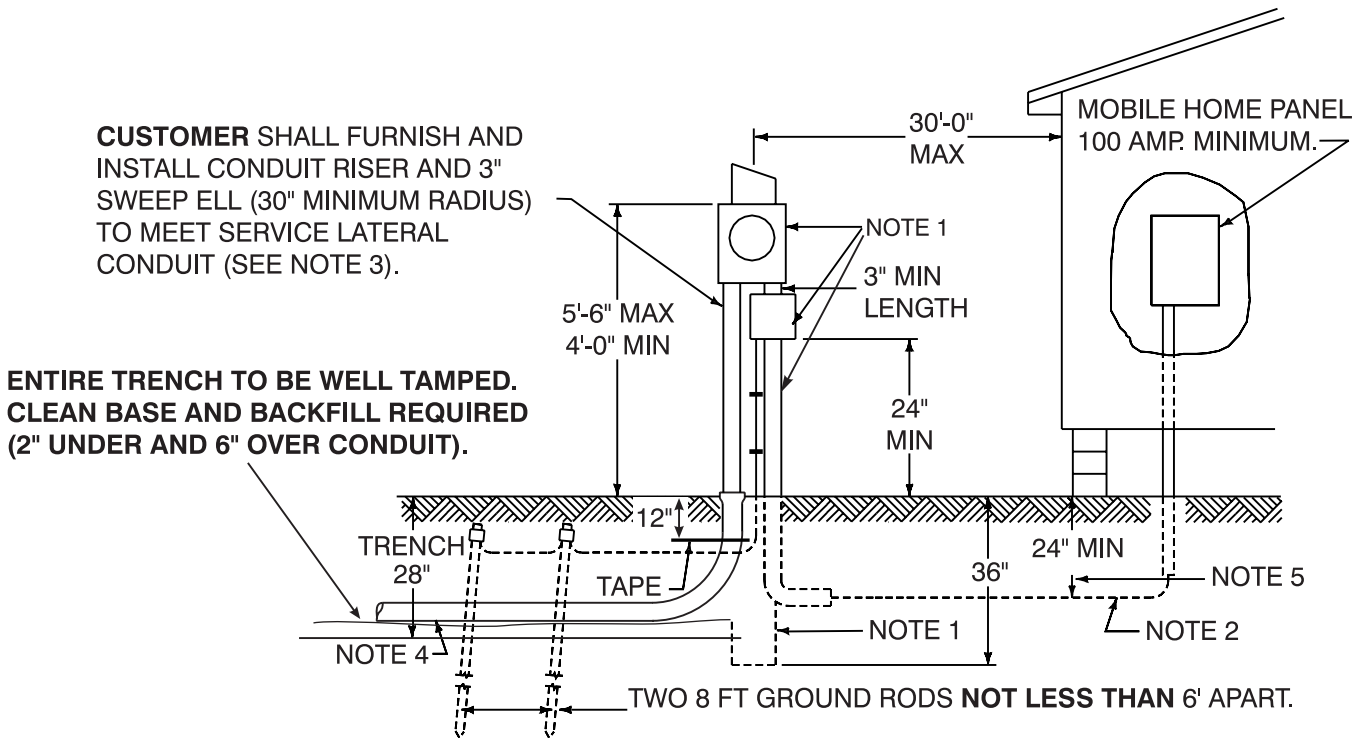

NOTES:

1. **CUSTOMER** SHALL FURNISH AND INSTALL 200 AMP. MINIMUM METER SOCKET; 100 AMP. MINIMUM MAIN DISCONNECT AND MEANS FOR CONNECTING AN ACCESSORY BUILDING OR ADDITIONAL ELECTRICAL EQUIPMENT LOCATED OUTSIDE MOBILE HOME; AND APPROPRIATE CONDUIT TYPE WHEN USED ON MINIMUM SIZE 4"x4"x8' PRESSURE TREATED POST. METERING PEDESTAL OR METER SOCKET/MAIN DISCONNECT COMBINATION ALSO ACCEPTABLE (SEE SECTION 6.08). SERVICE DISCONNECT SHALL BE LOCATED WITHIN SIGHT OF AND WITHIN 30 FEET OF THE MOBILE HOME. **WEST VIRGINIA ONLY:** METER SOCKETS FURNISHED BY COMPANY.
2. **CUSTOMER** SHALL FURNISH AND CONNECT ALL LOAD SIDE CONDUCTORS. COMPANY WILL CONNECT LINE SIDE CONDUCTORS AND INSTALL METER. CUSTOMER SHALL FURNISH AND INSTALL 4-WIRE, PERMANENT WIRING IF OVER 50 AMPS.
3. **CUSTOMER** SHALL FURNISH AND INSTALL CONDUIT RISER AND SWEEP ELL. CONDUIT RISER AND SWEEP ELL SHALL BE 3" **SCHEDULE 80 PVC** OR EQUIVALENT. SERVICE LATERAL CONDUIT SHALL BE 3" DIAMETER TYPE II PVC RIGID CONDUIT - DB60, DB120 OR SCHEDULE 40. ALL CONDUIT MUST BE ELECTRICAL GRADE.
4. **CUSTOMER** TO TRENCH AND BACKFILL; FURNISH AND INSTALL CONDUIT WITH 1/4" NYLON OR POLYPROPYLENE PULL ROPE FOR COMPANY SERVICE LATERAL CONDUCTORS. TRENCH TO BE EXCAVATED IN LOCATION INDICATED BY COMPANY. IDENTIFICATION TAPE PROVIDED BY COMPANY AND INSTALLED BY **CUSTOMER**.
5. BURIAL DEPTH MAY BE REDUCED TO 18" IF FEEDER IS IN CONDUIT.
6. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
7. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS (SEE SECTION 4.06) OBTAINED BEFORE COMPANY WILL PROVIDE SERVICE
8. **CUSTOMER** SHALL PROVIDE 3" TYPE II PVC OR SCHEDULE 40 SWEEP ELL (30" MINIMUM RADIUS) AT TERMINAL POLE OR PAD MOUNTED TRANSFORMER. CONTACT COMPANY FOR INSTALLATION DETAILS.