


UNDERGROUND TRANSFORMER-RATED METERING INSTALLATION (3-PHASE, 4-WIRE SERVICE)

CONSULT COMPANY FOR DETAILS BEFORE INSTALLATION.

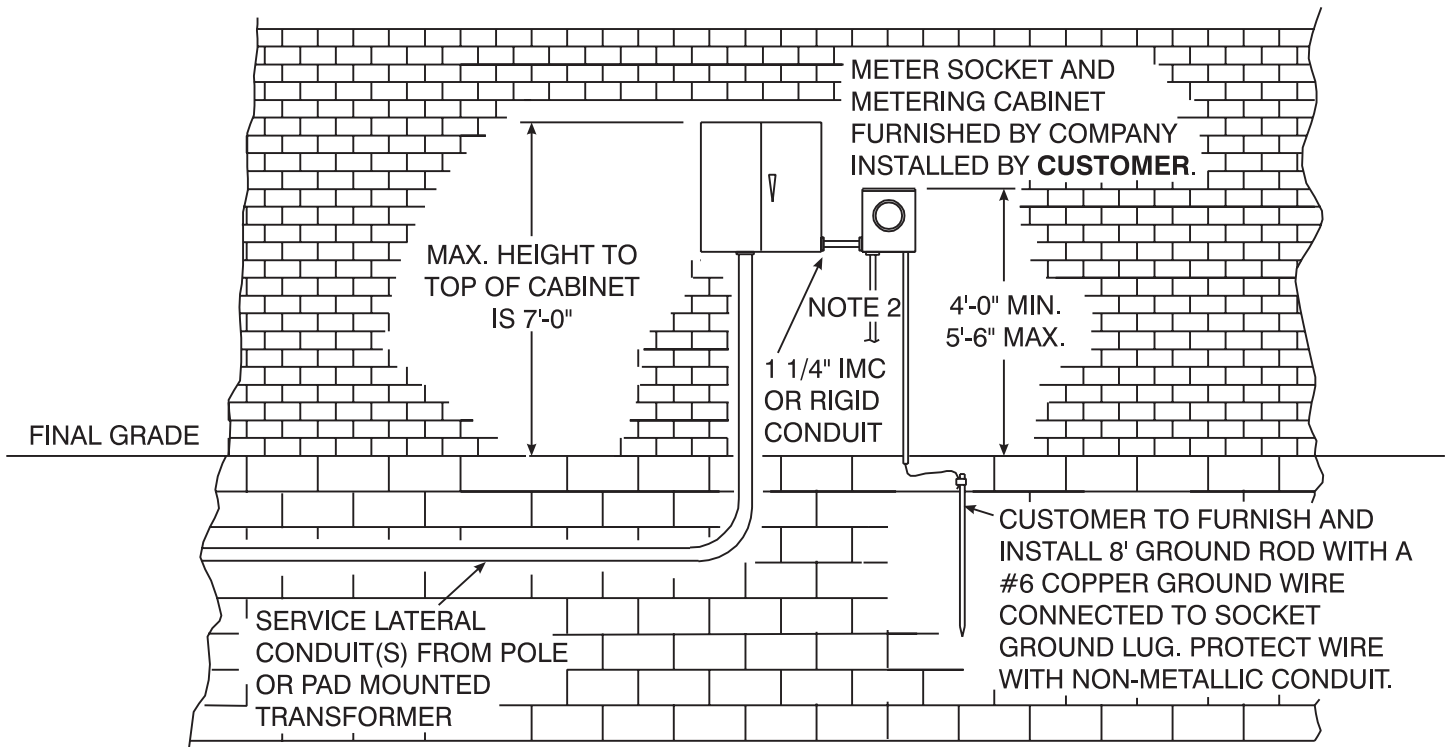

NOTES:

1. FOR METERING LOCATED ON BUILDING, SERVICE LATERAL CONDUIT(S) SHALL BE FURNISHED AND INSTALLED BY **CUSTOMER**, OWNED AND MAINTAINED BY COMPANY. TRENCHING AND BACKFILLING IS RESPONSIBILITY OF CUSTOMER. CONDUIT SHALL HAVE WEEP HOLES AT GROUND LINE WHEN REQUIRED. CUSTOMER TO FURNISH A 1/4" NYLON OR POLYPROPYLENE PULL ROPE IN THE SERVICE LATERAL CONDUIT(S). COMPANY WILL PROVIDE AND INSTALL ALL SERVICE LATERAL CONDUCTORS.
2. **CUSTOMER** SHALL FURNISH AND INSTALL 1-1/4" DIAMETER CONDUIT WITH 1/4" NYLON OR POLYPROPYLENE PULL ROPE FROM METER SOCKET TO A LOCATION AT CUSTOMER'S BUILDING WHERE TELEPHONE LINE SERVICE CAN BE MADE AVAILABLE AT THE TELEPHONE DEMARCATION POINT (SEE SECTION 8.08).
3. SERVICE LATERAL INSTALLED IN CONDUIT SHALL BE INSTALLED AS A-B-C-N IN EACH CONDUIT.
4. COMPANY WILL PROVIDE ALL CONNECTORS AND MAKE ALL CONNECTIONS AT METERING CABINET.
5. **CUSTOMER** SHALL GIVE COMPANY ADEQUATE ADVANCE NOTICE AS TO NUMBER AND SIZE OF CONDUCTORS **CUSTOMER** WILL INSTALL.