


# CLEARANCE REQUIREMENTS FROM BUILDINGS FOR PAD-MOUNTED TRANSFORMER

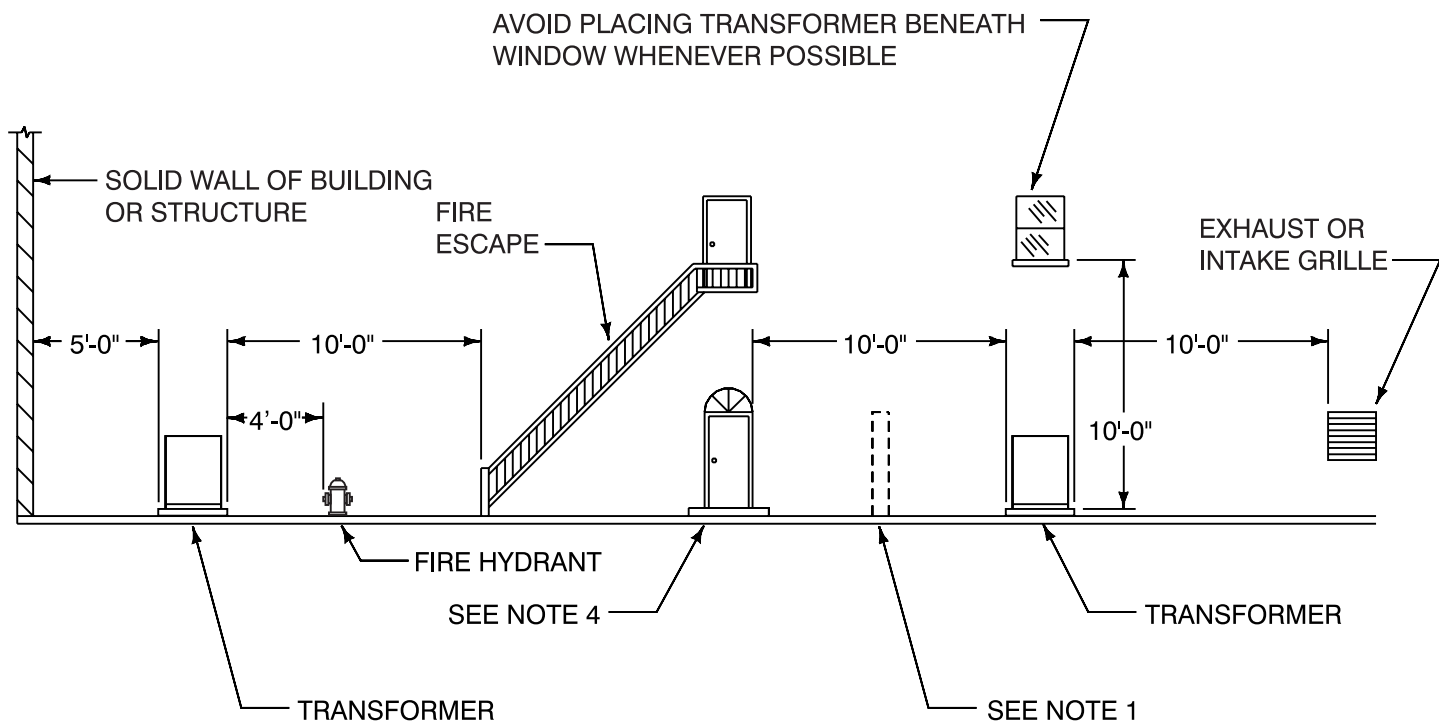

**NOTES:**

1. IN CASES WHERE REQUIRED DISTANCES CANNOT BE OBTAINED, FIRE RESISTANT BARRIER OF 6' MINIMUM HEIGHT SHALL BE CONSTRUCTED.
2. CERTAIN CONDITIONS MAY REQUIRE CURBING TO CONFINE OIL IN CASE OF TANK RUPTURE.
3. NO PORTION OF BUILDING OR BUILDING STRUCTURE SHALL OVERHANG ANY PART OF PAD-MOUNTED TRANSFORMER.
4. FIREPROOF DOOR, FOR EXITS FROM PUBLIC ASSEMBLY, SUCH AS AUDITORIUM, 10' CLEARANCE TO TRANSFORMER SHOULD BE INCREASED TO 25', UNLESS THERE IS BARRIER.