


TYPICAL 320 AMP OR LESS OVERHEAD SERVICE INSTALLATION

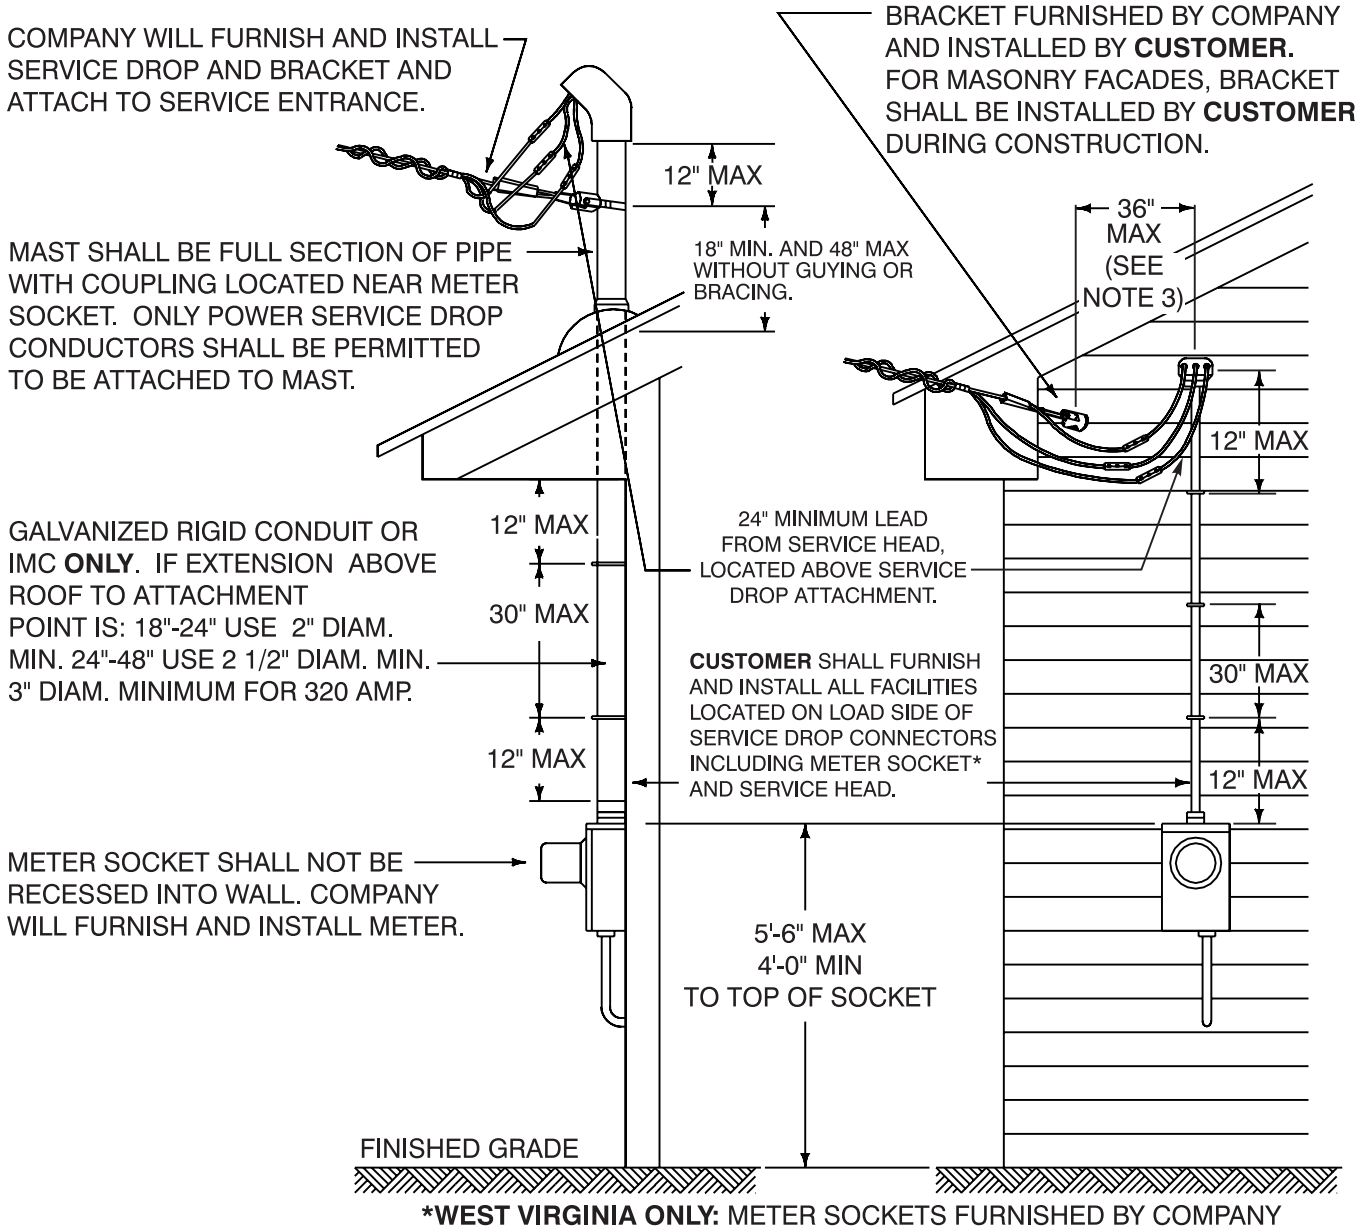

NOTES:

1. SEE FIGURE 1 FOR MINIMUM GROUND CLEARANCE.
2. SEE FIGURE 2 FOR GROUNDING REQUIREMENTS.
3. **CUSTOMER** SHALL CONSULT COMPANY FOR POINT OF ATTACHMENT OF SERVICE DROP AND METER LOCATION. IF COMPANY AGREES TO ALLOW CUSTOMER TO INSTALL BRACKET ABOVE SERVICE HEAD, BRACKET SHALL BE LOCATED NO MORE THAN 24 INCHES FROM SERVICE HEAD.
4. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
5. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS (SEE SECTION 4.06) OBTAINED BEFORE COMPANY WILL PROVIDE SERVICE.
6. FOR METER SOCKET SPECIFICATIONS AND MOUNTING, SEE SECTION 9.