


PAD FOUNDATION PAD-MOUNTED TRANSFORMER SINGLE PHASE

CONSULT COMPANY FOR DETAILS BEFORE INSTALLATION.

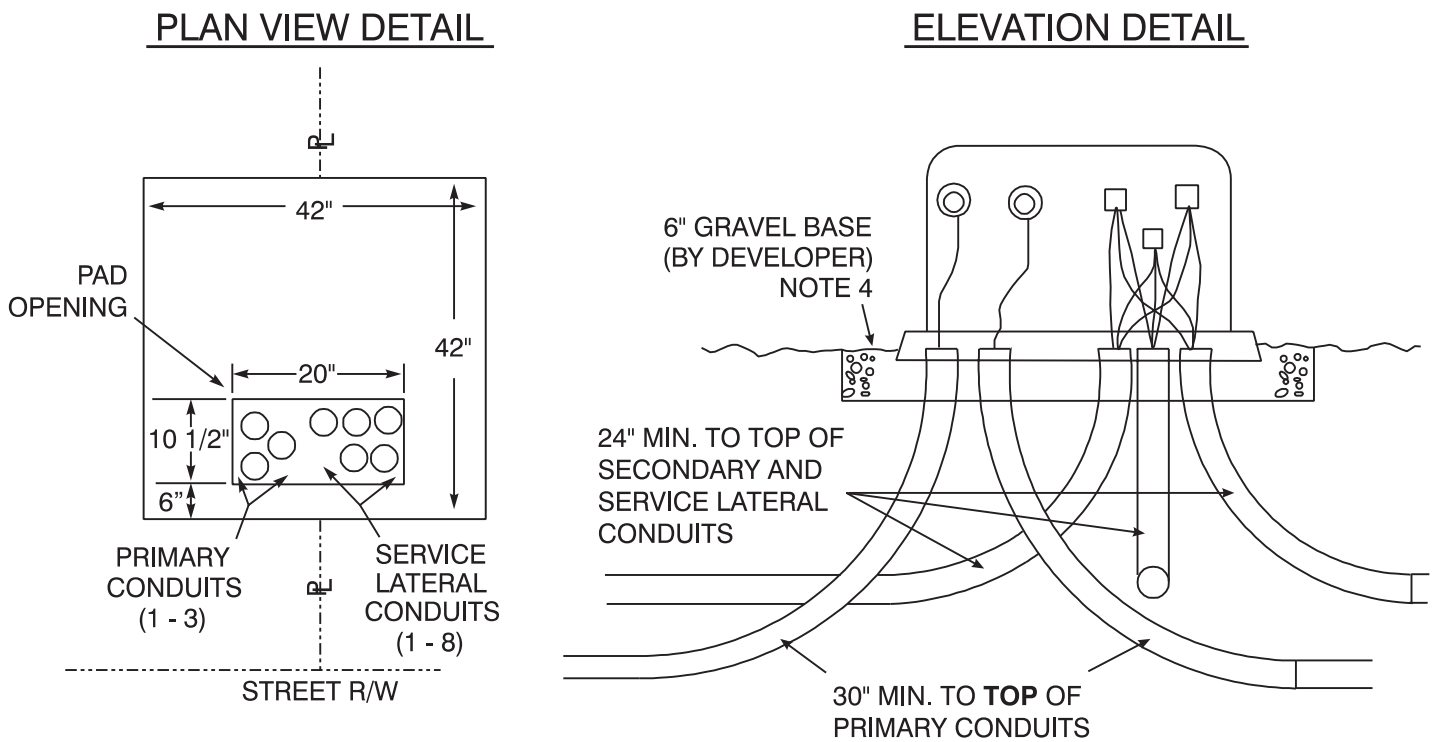

NOTES:

1. PRIMARY CONDUITS ARE LOCATED ON THE LEFT SIDE OF THE PAD OPENING.
2. SERVICE LATERAL CONDUITS ARE LOCATED ON THE RIGHT SIDE OF THE PAD OPENING.
3. ELEVATION VIEW IS FROM THE STREET SIDE OF THE TRANSFORMER.
4. **CUSTOMER** IS RESPONSIBLE FOR SITE PREPARATION (GRAVEL, CONDUIT, ETC.).