

POLE MOUNTED SELF-CONTAINED METER NOT EXCEEDING 320 AMPS, CUSTOMER CENTRAL DISTRIBUTION SERVICE


COMPANY WILL FURNISH AND INSTALL SERVICE DROP AND BRACKET AND WILL CONNECT TO SERVICE ENTRANCE.

CUSTOMER TO PROVIDE
24" MINIMUM WIRE LEAD
FROM SERVICE HEAD.

SEPARATE CONDUIT, SERVICE ENTRANCE
CABLE OR RACEWAY REQUIRED FOR METERED
AND UNMETERED CONDUCTORS.

CUSTOMER SHALL FURNISH AND INSTALL ALL
SERVICE ENTRANCE FACILITIES LOCATED ON
LOAD SIDE OF SERVICE DROP CONNECTORS
(INCLUDES METER SOCKET* AND
WEATHERPROOF AND SEALABLE FUSE
DISCONNECT OR BREAKER PANELBOARD).

COMPANY WILL FURNISH AND INSTALL METER.

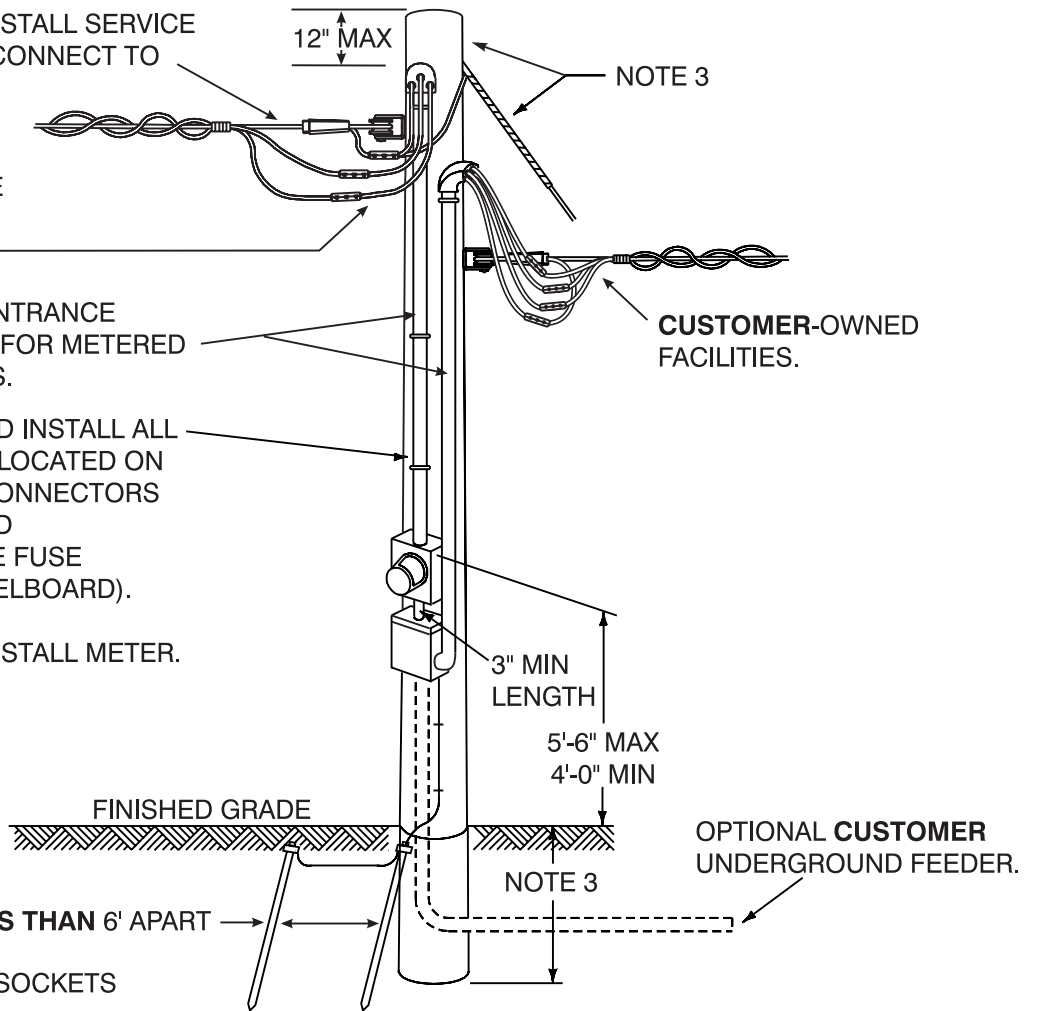

TWO 8' GROUND RODS **NOT LESS THAN 6' APART**

***WEST VIRGINIA ONLY:** METER SOCKETS
FURNISHED BY COMPANY

NOTES:

1. **CUSTOMER** SHALL CONSULT WITH COMPANY BEFORE INSTALLING CENTRAL DISTRIBUTION SERVICE.
2. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS (SEE SECTION 4.06) OBTAINED BEFORE COMPANY WILL PROVIDE SERVICE.
3. **CUSTOMER** SHALL FURNISH AND INSTALL COMPANY APPROVED POLE TREATED WITH CHEMICAL PRESERVATIVE. MINIMUM POLE REQUIREMENTS: 30' LENGTH, CLASS 6; INSTALLED MINIMUM 5' IN GROUND AND WELL TAMPED. IF SERVICE DROP EXCEEDS 100' OR PROPER SETTING DEPTH CANNOT BE OBTAINED, **CUSTOMER** SHALL INSTALL PROPER GUYING. COMPANY WILL BOND GUY TO SERVICE NEUTRAL.
4. ANTENNAS OR AERIALS SHALL NOT BE ATTACHED TO ANY POLE USED FOR SUPPLY OF ELECTRIC SERVICE TO **CUSTOMER**.
5. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
6. WHEN LOAD EXCEEDS 320 AMPS., SEE FIGURE 11.