


# POLE MOUNTED SELF CONTAINED METER NOT EXCEEDING 320 AMPS, CUSTOMER CENTRAL DISTRIBUTION SERVICE WITH STAND-BY GENERATOR FACILITIES

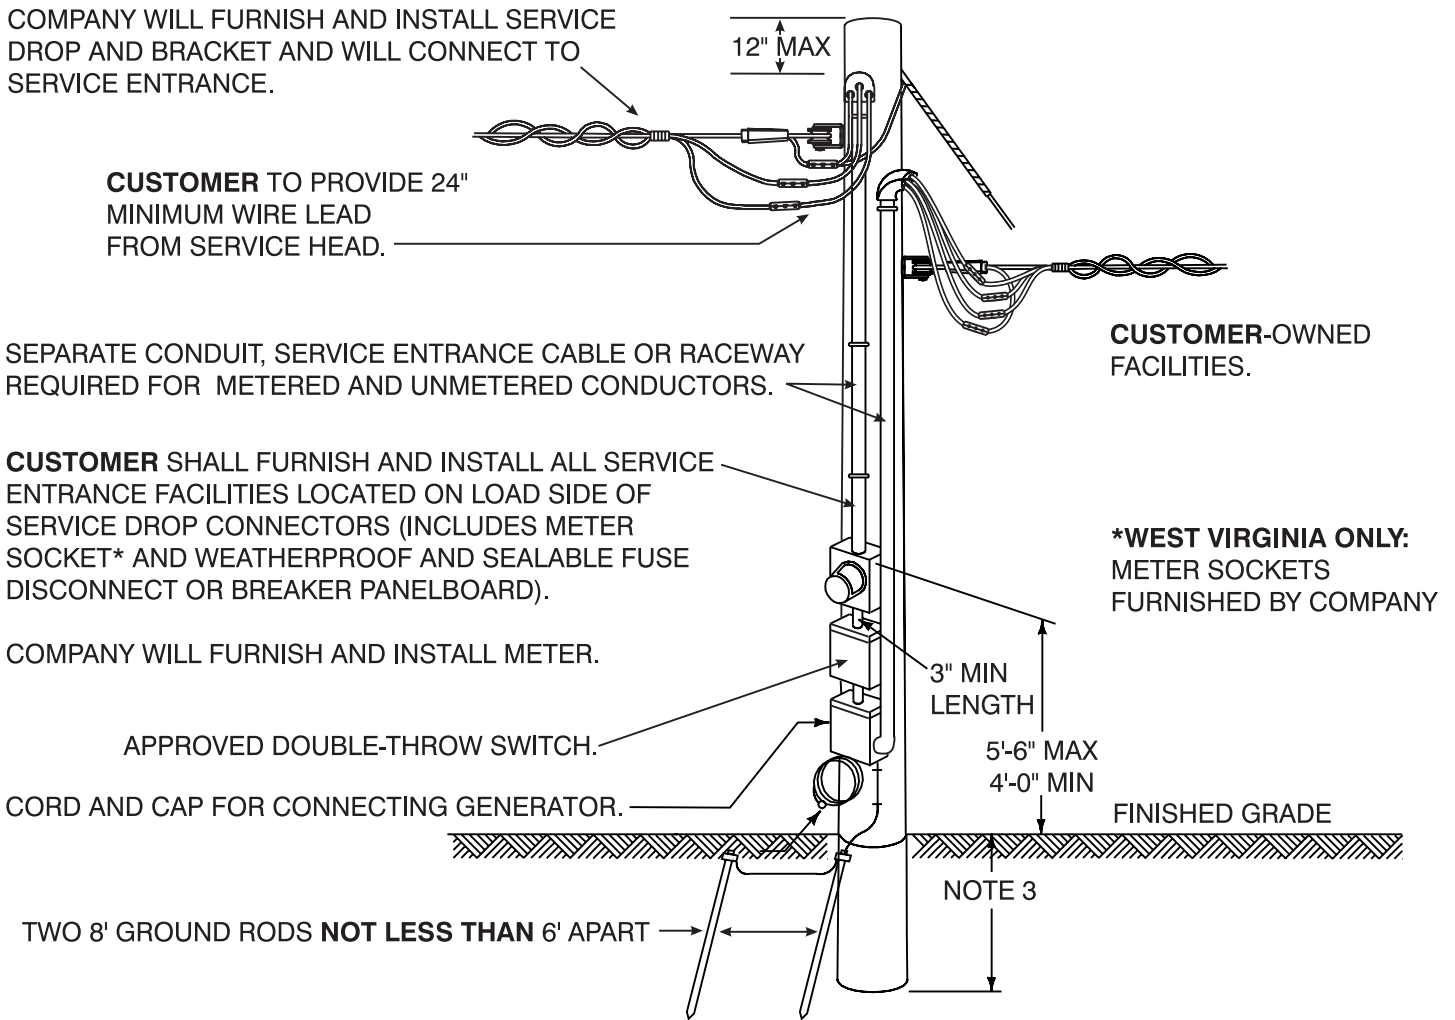

**NOTES:**

1. **CUSTOMER SHALL CONSULT WITH COMPANY** BEFORE INSTALLING CENTRAL DISTRIBUTION SERVICE.
2. ALL EMERGENCY STAND-BY GENERATOR FACILITIES SHALL BE INSTALLED IN ACCORDANCE WITH APPLICABLE CODES AND BE SUBJECT TO COMPANY APPROVAL.
3. **CUSTOMER** SHALL FURNISH AND INSTALL COMPANY APPROVED POLE TREATED WITH CHEMICAL PRESERVATIVE. MINIMUM POLE REQUIREMENTS: 30' LENGTH, CLASS 6; INSTALLED MINIMUM 5' IN GROUND AND WELL TAMPED. IF SERVICE DROP EXCEEDS 100' OR PROPER SETTING DEPTH CANNOT BE OBTAINED, **CUSTOMER** SHALL INSTALL PROPER GUYING. COMPANY WILL BOND GUY TO SERVICE NEUTRAL.
4. ANTENNAS OR AERIALS SHALL NOT BE ATTACHED TO ANY POLE USED FOR SUPPLYING ELECTRIC SERVICE TO **CUSTOMER**.
5. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
6. ALL **CUSTOMER** WORK SHALL BE COMPLETED AND INSPECTIONS (SEE SECTION 4.06) OBTAINED BEFORE COMPANY WILL PROVIDE SERVICE.
7. WHEN LOAD EXCEEDS 320 AMPS, SEE FIGURE 11.